

TITLE
PWHG.5x2.5x2-50

DRAWN BY
 C.Larkin

DATE
 23/05/2024


Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

DESCRIPTION:
 PWHG.5x2.5x2-50
KIOSK

SCALE:1:60 SHEET 1 OF 2

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	4700 x 2200 x 2000mm
EXTERNAL DIMENSIONS	5075 x 2575 x 2200mm
INSULATION THICKNESS	50mm
MATERIAL	GRP - GREY



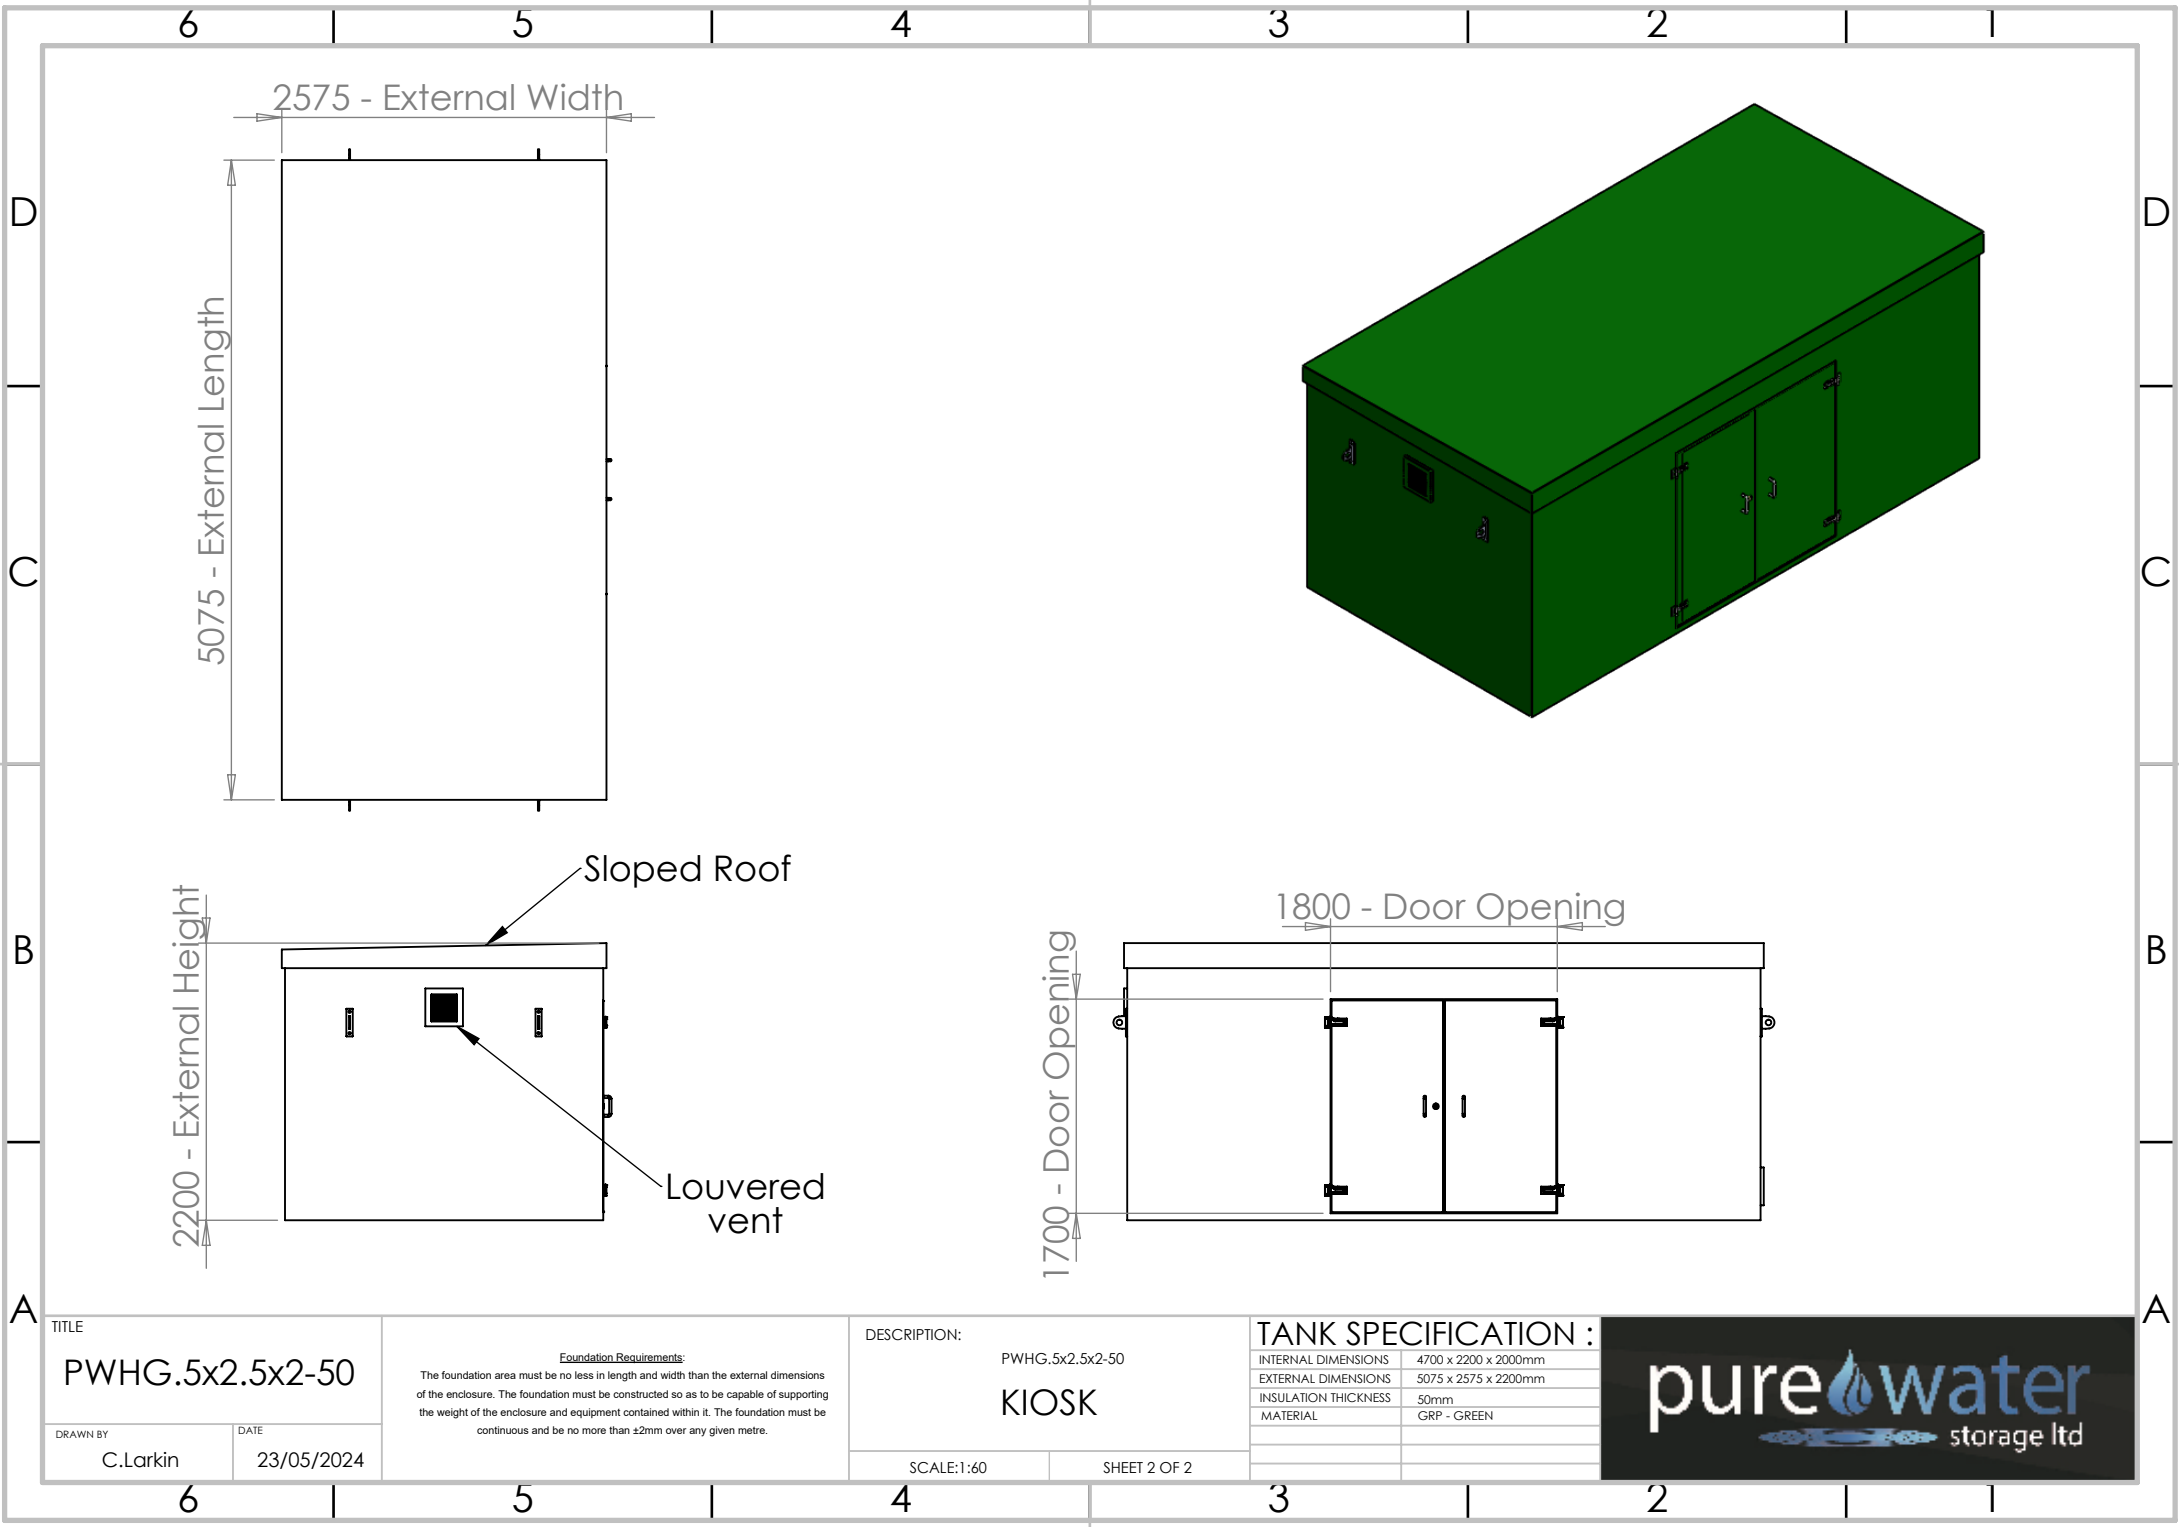

2575 - External Width

5075 - External Length

Sloped Roof

2200 - External Height

Louvered vent

1800 - Door Opening

1700 - Door Opening

TITLE
PWHG.5x2.5x2-50
 DRAWN BY: C.Larkin
 DATE: 23/05/2024

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

DESCRIPTION:
 PWHG.5x2.5x2-50
KIOSK
 SCALE:1:60
 SHEET 2 OF 2

TANK SPECIFICATION :

INTERNAL DIMENSIONS	4700 x 2200 x 2000mm
EXTERNAL DIMENSIONS	5075 x 2575 x 2200mm
INSULATION THICKNESS	50mm
MATERIAL	GRP - GREEN

