
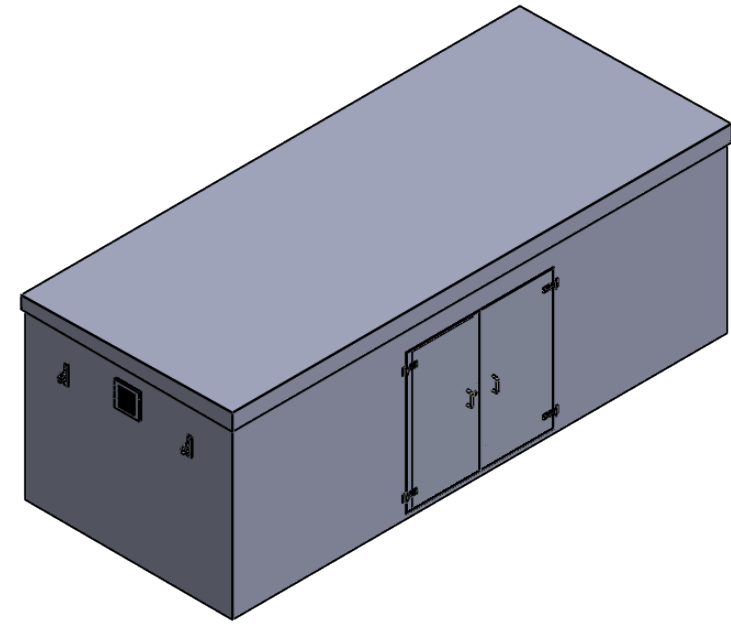



2575 - External Width

6075 - External Length



2200 - External Height


Sloped Roof

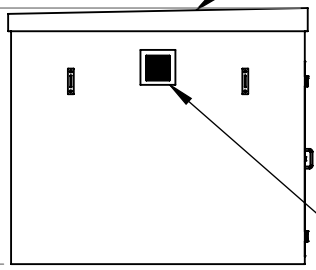

Louvered vent

1800 - Door Opening

1700 - Door Opening

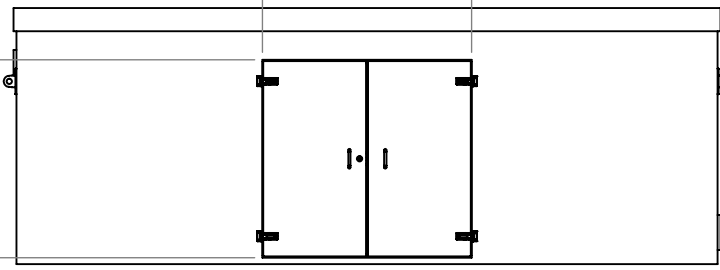

TITLE	
PWHG.6x2.5x2	
DRAWN BY	DATE
C.Larkin	23/05/2024

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.



DESCRIPTION:	
PWHG.6x2.5x2	
KIOSK	
SCALE:1:65	SHEET 1 OF 2

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	5860 x 2360 x 2000mm
EXTERNAL DIMENSIONS	6075 x 2575 x 2200mm
INSULATION THICKNESS	18mm
MATERIAL	GRP - GREY




2575 - External Width

6075 - External Length

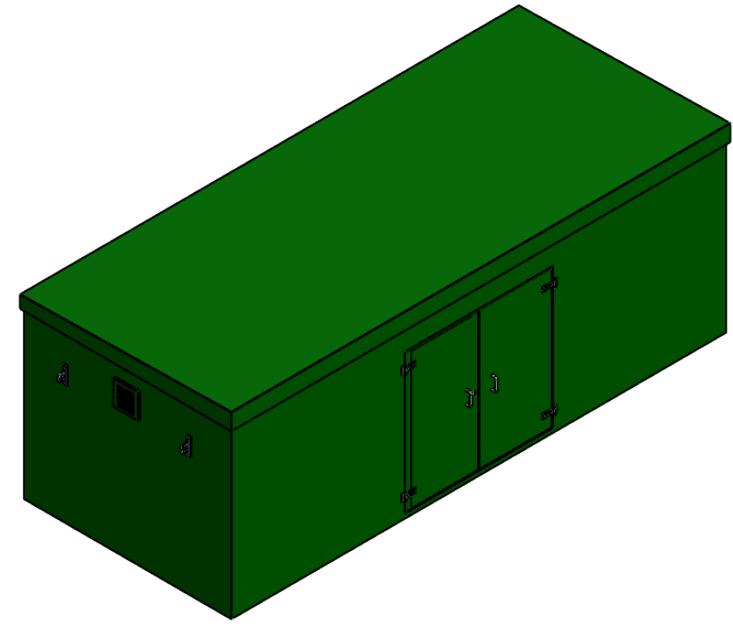

2200 - External Height


Sloped Roof

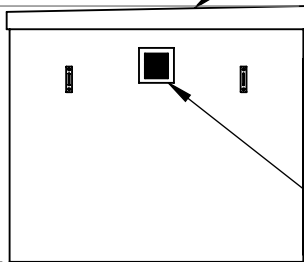

Louvered vent

1700 - Door Opening

1800 - Door Opening

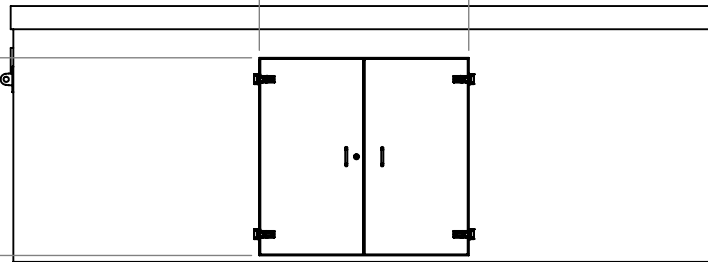

TITLE	
PWHG.6x2.5x2	
DRAWN BY	DATE
C.Larkin	23/05/2024

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

DESCRIPTION:	
PWHG.6x2.5x2	
KIOSK	
SCALE:1:65	SHEET 2 OF 2

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	5860 x 2360 x 2000mm
EXTERNAL DIMENSIONS	6075 x 2575 x 2200mm
INSULATION THICKNESS	18mm
MATERIAL	GRP - GREEN

