

2575 - External Width

7075 - External Length

Sloped Roof

3200 - External Height

Louvered vent

1800 - Door Opening

2000 - Door Opening

| | |
|--------------|------------|
| TITLE | |
| PWHG.7x2.5x3 | |
| DRAWN BY | DATE |
| C.Larkin | 23/05/2024 |

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.



| | |
|--------------|--------------|
| DESCRIPTION: | |
| PWHG.7x2.5x3 | |
| KIOSK | |
| SCALE:1:80 | SHEET 1 OF 2 |

| | |
|----------------------|----------------------|
| TANK SPECIFICATION : | |
| INTERNAL DIMENSIONS | 6860 x 2360 x 3000mm |
| EXTERNAL DIMENSIONS | 7075 x 2575 x 3200mm |
| INSULATION THICKNESS | 18mm |
| MATERIAL | GRP - GREY |
| | |
| | |




2575 - External Width

7075 - External Length

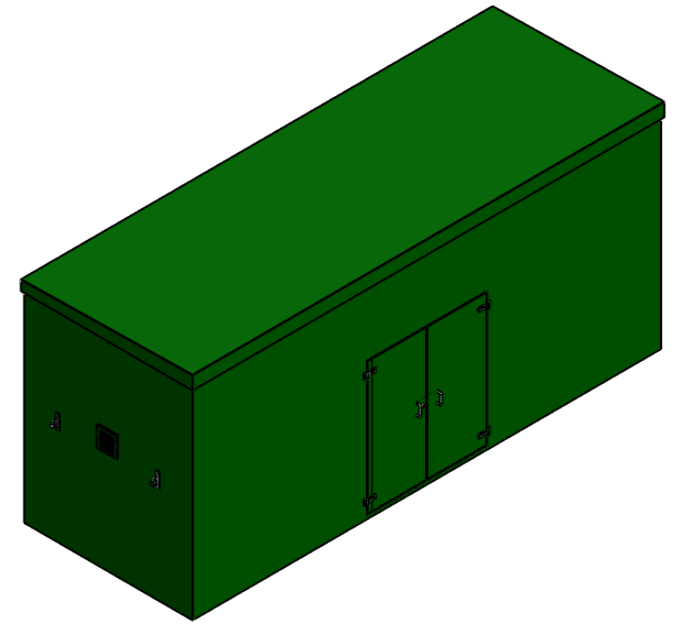


Sloped Roof

3200 - External Height

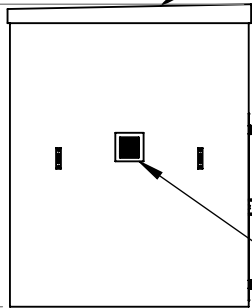

Louvered vent

1800 - Door Opening

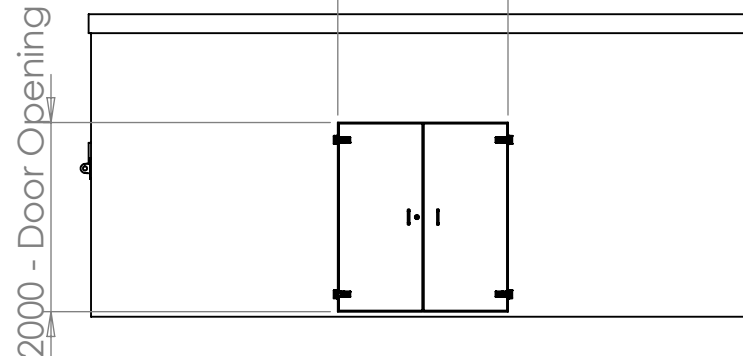

| | |
|--------------|------------|
| TITLE | |
| PWHG.7x2.5x3 | |
| DRAWN BY | DATE |
| C.Larkin | 23/05/2024 |

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

| | |
|--------------|--------------|
| DESCRIPTION: | |
| PWHG.7x2.5x3 | |
| KIOSK | |
| SCALE:1:80 | SHEET 2 OF 2 |

| | |
|----------------------|----------------------|
| TANK SPECIFICATION : | |
| INTERNAL DIMENSIONS | 6860 x 2360 x 3000mm |
| EXTERNAL DIMENSIONS | 7075 x 2575 x 3200mm |
| INSULATION THICKNESS | 18mm |
| MATERIAL | GRP - GREEN |
| | |
| | |

