


View 4

View 2

View 4

View 3

View 2

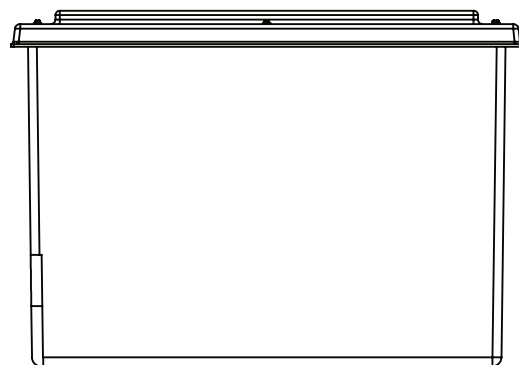

View 3

Connections:

- A - Inlet 1 No pad T1 only.
- B - Lid vent None
- D - Overflow 1 No pad T2 only.
- F1 - Outlet 1 No pad T1 only.
- G - Drain 1 No pad T1 only.

Drawing Approval Date	
Name	
Signature	

I am signing to approve this drawing to progress my order in the build program. I accept that I cannot cancel this order following my signature of approval.

RUBBED DOWN BY

TITLE  
**STANDARD POSITIONS**

DRAWN BY  
C.LARKIN

DATE  
30/11/2023

CUSTOMER  
CUSTOMER

**NOTE:**  
All tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DESCRIPTION:  
**PW570.AG**

NOTES	
DATE	04/02/2023
FIRST ISSUE	xxx
VERSION	xxx

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	990 x 760 x 760mm
EXTERNAL DIMENSIONS	1150 x 925 x 800mm
NOMINAL CAPACITY	570 Litres
INSULATION THICKNESS	25mm
STEEL BRACINGS	NONE
ENCAPSULATED BASEBOARD	NONE
TANK COLOUR	GREY - 00A05



ALL DIMENSIONS +/- 5mm UNLESS OTHERWISE STATED

A3

ALL DIMENSIONS IN MM - DO NOT SCALE

SCALE:1:17

SHEET 1 OF 1