




View 1

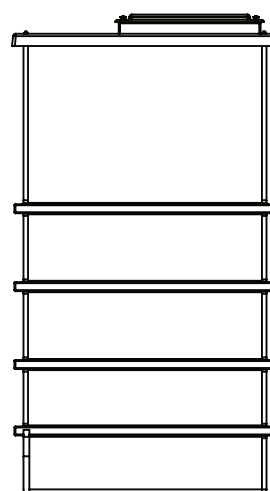


View 1



View 3

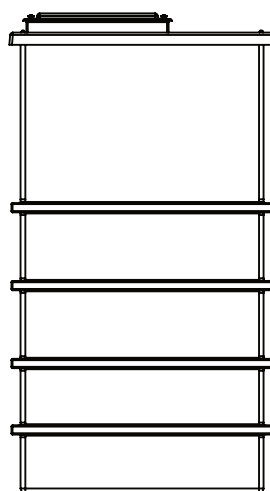

View 3

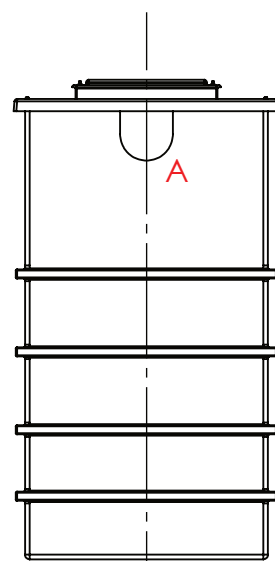


View 4

View 4

A

View 2

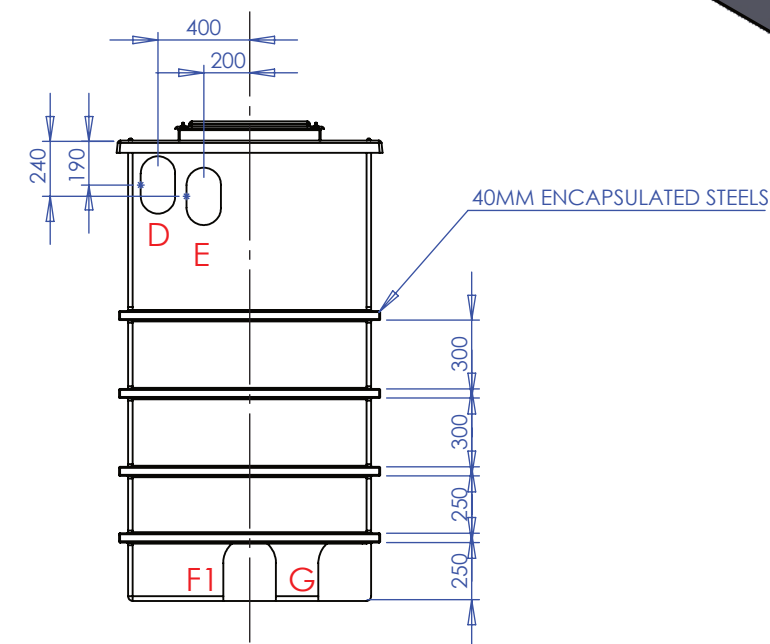

View 2

Connections:

- A - Inlet 1 No pad T1
- D - Overflow 1 No pad T2
- E - Warning pipe 1 No pad T2
- F1 - Outlet 1 No pad T1
- G - Drain 1 No pad T1

Drawing Approval Date	
Name	
Signature	
<p style="color: red; font-size: small;">I am signing to approve this drawing to progress my order in the build program. I accept that I cannot cancel this order following my signature of approval.</p>	

RUBBED DOWN BY	PRINT NAME
----------------	------------

TITLE	
STANDARD POSITIONS.	
DRAWN BY	DATE
C.LARKIN	28/03/2024
CUSTOMER	CUSTOMER

**NOTE:**  
All tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

ALL DIMENSIONS +/- 5mm UNLESS OTHERWISE STATED

DESCRIPTION:

PW2001.AG

A3

ALL DIMENSIONS IN MM - DO NOT SCALE

NOTES	DATE	TANK SPECIFICATION :	
	08/03/2023	INTERNAL DIMENSIONS	1000 x 1000 x 2000mm
FIRST ISSUE	xxx	EXTERNAL DIMENSIONS	1180 x 1180 x 2093mm
VERSION	xxx	NOMINAL CAPACITY	2000 Litres
		INSULATION THICKNESS	25mm
		STEEL BRACINGS	4 No 40mm bands
		ENCAPSULATED BASEBOARD	NONE
		TANK COLOUR	GREY - 00A05



SCALE:1:33

SHEET 1 OF 1