
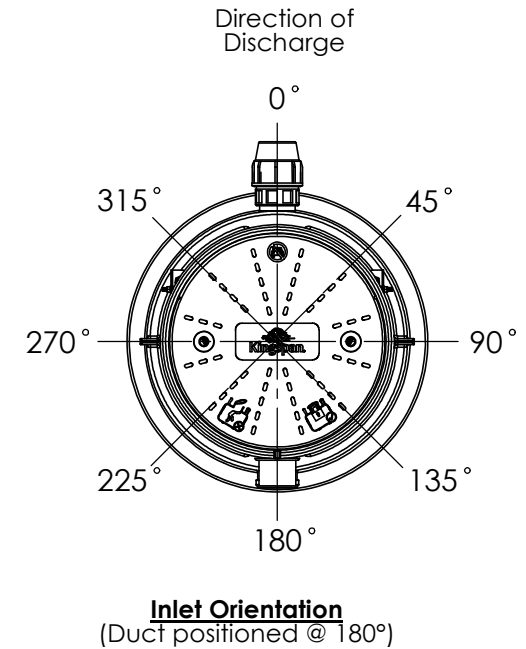
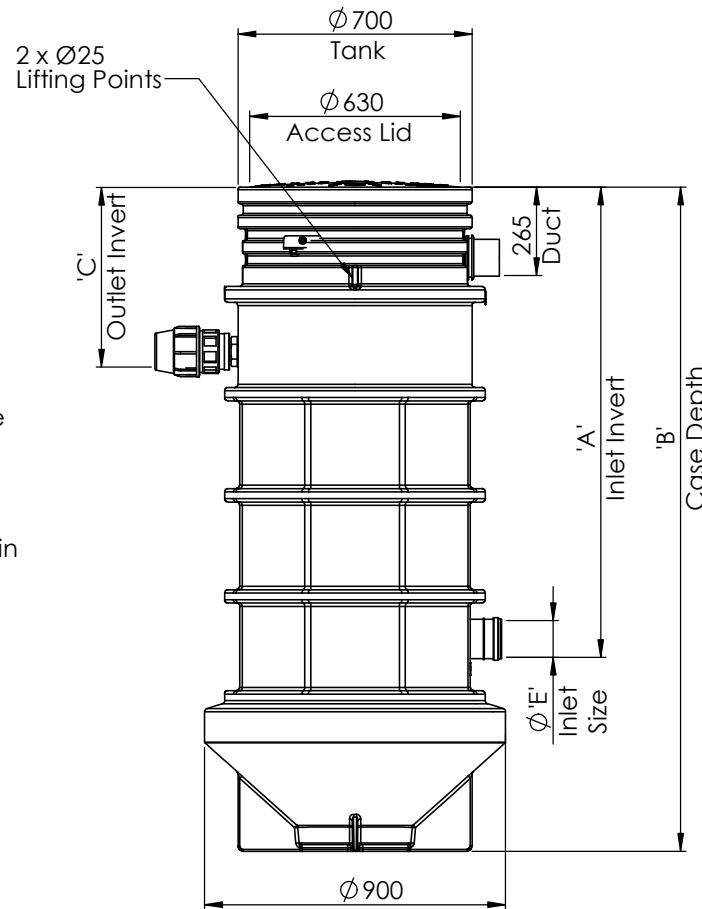


Notes:

- Pumpwell delivered with pumps installed. Control panel and Float switches attached to pallet.
- Pumps to be coupled to chains with shackles supplied on lifting chain which is connected to the unistrut assembly.
- Read Operating and Installation guidelines before installing.

Case Ø	Outlet Invert 'C'	Case Depth 'B'			Inlet Invert 'A'			Inlet Size 'E'
		PX2	PX3	PX4	05	11	14	
		10 (1.0m)	16 (1.6m)	19 (1.9m)	0.5m	1.1m	1.4m	
09 (0.9m)	0.5m	•			•			110mm
			•			•		160mm

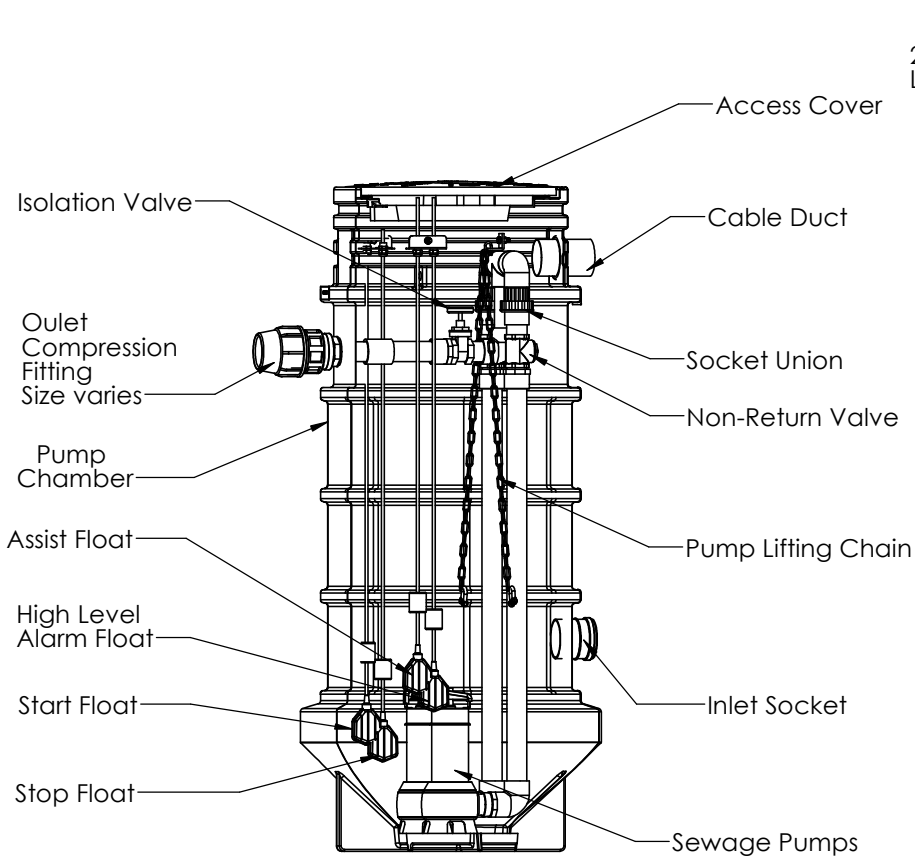

Please check with Kingspan Water & Energy for the latest Issue of the drawing

Issue	Date	Drawn By	Approved By	Description
03	14/11/2024	D.Musvaburi	D.M	ECN 2147
02	09/10/2024	D. Musvaburi	D.M	ECN 2128

LN Number :
Finish :
Weight :
Modelled By :

Tolerance (unless stated) :
Thickness :
Surface Area : m²
Material :


Drawing : DS1490P

Page 1 of 1

Ø0.9m PE Twin Sewage Pump Chamber

All Dimensions In mm

Scale: Do Not Scale



Third Angle Projection

Kingspan Water & Energy reserve the right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without the written permission of Kingspan Water & Energy

